


**BL compact™ multiprotocol fieldbus station for Industrial Ethernet
2 Analog Inputs for Pt and Ni Sensors and 8 Configurable Digital PNP
Channels****BLCEN-6M12LT-2AI-PT-8XSG-P**

- On-machine Compact fieldbus I/O block
- EtherNet/IP™, Modbus® TCP, or PROFINET slave
- Integrated Ethernet Switch
- 10 Mbps / 100 Mbps supported
- Two 4-pole M12, D-coded, connectors for fieldbus connection
- 2 rotary switches for node address
- IP67, IP69K
- M12 I/O connectors
- LEDs indicating status and diagnostics
- Electronics galvanically separated from the field level via optocouplers
- 8 Configurable digital PNP channels, 24 VDC
- Max. 0.5A per channel
- Selection of filtering times (Input delay)
- Invertible inputs
- 2 analog inputs for RTDs
- Pt100, Pt200, Pt500, Pt1000, Ni100, Ni1000, 0...100Ω, 0...200Ω, 0...400Ω, or 0...1000Ω (selectable per channel)

Type designation	BLCEN-6M12LT-2AI-PT-8XSG-P
Ident-No.	6811515
Nominal system voltage	24 VDC
System power supply	Via auxiliary power
Voltage supply connection	2 x M12, 5-pin
Admissible range Vi	18...30VDC
Nominal current Vi	270 mA
Max. current Vi	2 A
Admissible range Vo	18...30VDC
Nominal current Vo	100 mA
Max. current Vo	4 A
Electrical isolation	The inputs and outputs of the 8XSG I/O cards are supplied via a common ground. Therefore, it is recommend not to use this module for safety or emergency stop applications.
Fieldbus transmission rate	10/100 Mbps
Adjustment transmission rate	Automatic detection
Fieldbus address range	1...92 0 (192.168.1.254) 93 (BootP) 94 (DHCP) 95 (PGM) 96 (PGM-DHCP) *Recommended for PROFINET 97...98 (manufacturer specific)
Fieldbus addressing	2 decimally coded rotary switches
Fieldbus connection technology	2 x M12 4-pole, D-coded
Protocol detection	automatic
Web server	Integrated
Service interface	Ethernet
Vendor ID	48
Product type	12
Product code	11515
Modbus TCP	
Addressing	Static IP, BOOTP, DHCP
Supported function codes	FC1, FC2, FC3, FC4, FC5, FC6, FC15, FC16, FC23
Number of TCP connections	6
Input Data Size	max. 3 register
Input register start address	0 (0x0000 hex)
Output Data Size	max. 1 register
Output register start address	2048 (0x0800 hex)

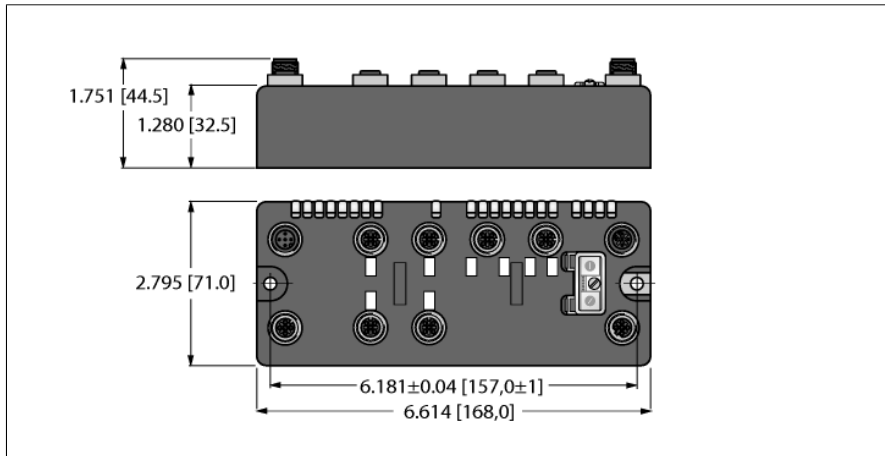

BL compact™ multiprotocol fieldbus station for Industrial Ethernet

2 Analog Inputs for Pt and Ni Sensors and 8 Configurable Digital PNP Channels

BLCEN-6M12LT-2AI-PT-8XSG-P

EtherNet/IP™

Addressing	acc. to EtherNet/IP™ specification
Device Level Ring (DLR)	supported
Class 1 connections (CIP)	6
Input Assembly Instance	103
Input Data Size	5 INT
Output Assembly Instance	104
Output Data Size	1 INT
Configuration Assembly Instance	106
Configuration Size	0
Comm Format	Data - INT

PROFINET

Addressing	DCP
Conformance class	B (RT)
MinCycleTime	1 ms
Diagnostics	acc. to PROFINET alarm handling
Topology detection	supported
Automatic addressing	supported
Media Redundancy Protocol (MRP)	supported
Input Data Size	max. 5 BYTE
Output Data Size	max. 2 BYTE

Digital inputs

Input type	From 8XSG PNP
Type of input diagnostics	Group diagnostics
Sensor supply (V_{SENS})	24 VDC
Low level signal voltage	4.5 V
Low level signal voltage	< 4.5 VDC
High level signal voltage	7...30 VDC
Low level signal current	< 1.5 mA
High level signal current	2.1...3.7 mA
Input delay	(configurable) 0.25 or 2.5 ms

Digital outputs

Output type	From 8XSG PNP
Sensor supply (V_{SENS})	24 VDC
Output current per channel	0.5 A
Output voltage	24 VDC
Output delay	3 ms
Load type	resistive, inductive, lamp load
Load resistance, resistive	> 48 Ω
Load resistance, inductive	< 1.2 H
Lamp load	< 3 W
Switching frequency, resistive	< 200 Hz
Switching frequency, inductive	< 2 Hz
Switching frequency, lamp load	< 20 Hz
Short-circuit protection	yes

Analog inputs

Operating modes	from 2AI-PT Pt100, 200, 500, 1000 & Ni100, 1000
Type of input diagnostics	Channel diagnostics
Sensor supply	24 VDC, 1 amp max.
Basic fault limit at 23 °C	< 0.2 %
Repeatability	< 0.05 %
Temperature coefficient	< 300 ppm / °C of full scale
Resolution	16 bit
Measurement display	16 bit signed integer 12 bit full range left-justified



BL compact™ multiprotocol fieldbus station for Industrial Ethernet
2 Analog Inputs for Pt and Ni Sensors and 8 Configurable Digital PNP
Channels
BLCEN-6M12LT-2AI-PT-8XSG-P

Dimensions	168 x 71 x 32.5 mm
Mounting	2 × 5.4 mm diameter holes, 1.7 Nm torque
Weight	600 ± 20 g
Housing material	Glass-filled nylon, nickel plated brass connectors
Housing color	Black
Window material	Lexan
Material screw	Nickel-plated brass
Material label	Polyester with polycarbonate overlay
Ground label material	Nickel plated brass
Protection class	IP67 IP69K
Operating temperature	-40...+70 °C
Storage temperature	-40...+85 °C
Relative humidity	15 to 95% (non-condensing)
Vibration test	according to IEC 61131-2
Extended vibration resistance	
- up to 20 g (at 10 up to 150 Hz)	For mounting on base plate or machinery
Shock test	according to IEC 61131-2
Electromagnetic compatibility	according to IEC 61131-2
Approvals and certificates	CE, cULus

BL compact™ multiprotocol fieldbus station for Industrial Ethernet
2 Analog Inputs for Pt and Ni Sensors and 8 Configurable Digital PNP
Channels
BLCEN-6M12LT-2AI-PT-8XSG-P

Pinning and wiring diagram

	Ethernet Fieldbus cable (IP67 example): RSSD RSSD 441-2M ID number U-02482 or RSSD-RSSD-441-2M/S2174 ID number 6914218	Pin Assignment (M12, D-code) 1 = TD + 2 = RD + 3 = TD - 4 = RD -
	Slot 1: RTD Inputs Extension cable (example): RK 4T-2-RS 4T/S3041 ident-no. U-1666 or RKC4.5T-2-RSC4.5/TEL ident-no. 6625212 NOTE: Do not connect Pin 3. Use only sensor cables without pin 3 or field-wireable connectors.	Pin Assignment 1 = S + 2 = PT + 3 = GND 4 = PT - 5 = PE 2-wire Technology 3-wire Technology
	Slot 2: Digital Inputs and Outputs Extension cable (example): RK 4.4T-2-RS 4.4T ident-no. U2445 or RKC4.4T-2-RSC4.4T/TEL ident-no. 6625208	Pin Assignment 1 = VSENS 2 = Signal B 3 = GND 4 = Signal A 5 = PE
	Auxiliary Power Extension cable (example): RKC 4.4T-2-RSC 4.4T ident-no. U5264 or RKC4.4T-2-RSC4.4T/TEL ident-no. 6625208	Pin Assignment 1 = Vi 2 = Vo 3 = GND 4 = GND 5 = PE



BL compact™ multiprotocol fieldbus station for Industrial Ethernet
2 Analog Inputs for Pt and Ni Sensors and 8 Configurable Digital PNP
Channels
BLCEN-6M12LT-2AI-PT-8XSG-P

Station LED status

LED	Color	Status	Description
IOs		OFF	No power
	RED	ON	Low power or station error
	RED	FLASHING (1 Hz)	I/O module configuration error
	RED	FLASHING (4 Hz)	No I/O module bus communication
	GREEN	ON	Station ok
	GREEN	FLASHING	Force mode active
BUS		OFF	Power Off
	GREEN	ON	Connected to Master
	GREEN	FLASHING	Ready
	GREEN	FLASHING 3x (1Hz)	ARGEE Running
	RED	ON	Error
	RED	FLASHING	WINK
	YELLOW	ON	DHCP/BOOTP Search
LNK/ACT		OFF	No Link
	GREEN	ON	Link
	GREEN	FLASHING	Traffic
	YELLOW	ON	100 Mbit Linked

I/O LED status slot 1

LED	Color	Status	Description
D1 *		OFF	No diagnostics active
	RED	ON	Station error/ module bus communication failure
	RED	FLASHING (0.5Hz)	Diagnostics active (Slot 1)
AI channels 0 / 1			Not connected

* D1 LED also indicates gateway diagnostics

I/O LED status slot 2

LED	Color	Status	Description
D2 *		OFF	No diagnostics active
	RED	ON	Station error/ module bus communication failure
	RED	FLASHING (0.5Hz)	Diagnostics active (Slot 2)
XSG channels 2 ₀ ...2 ₇		OFF	Channel status x = "0" (OFF), no diagnostics active
	GREEN	ON	Channel status x = "1" (ON)
	RED	ON	Short-circuit at output

* D2 LED also indicates gateway diagnostics

BL compact™ multiprotocol fieldbus station for Industrial Ethernet
2 Analog Inputs for Pt and Ni Sensors and 8 Configurable Digital PNP
Channels
BLCEN-6M12LT-2AI-PT-8XSG-P**Process Data Mapping of Each Protocol****EtherNet/IP™ I/O & Diagnostics Data Mapping**

INPUT	BYTE	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
	0	AI 1 ₀ LSB							
	1	AI 1 ₀ MSB							
	2	AI 1 ₁ LSB							
	3	AI 1 ₁ MSB							
	4	DI 2 ₇	DI 2 ₆	DI 2 ₅	DI 2 ₄	DI 2 ₃	DI 2 ₂	DI 2 ₁	DI 2 ₀
	5	-	-	-	-	-	-	-	-
Diagnostics	6	Module number reporting diagnostic data							
	7	Replace Station	-	Diagnostics Active	-	-	-	-	-
Slot 1 (ref. Byte 6)	8	-	-	-	-	-	Short Circuit AI 1 ₀	Open Circuit AI 1 ₀	Range Error AI 1 ₀
	9	-	-	-	-	-	Short Circuit AI 1 ₁	Open Circuit AI 1 ₁	Range Error AI 1 ₁
	10	Reserved							
	11	Reserved							
OUTPUT	BYTE	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
	0	DO 1 ₇	DO 1 ₆	DO 1 ₅	DO 1 ₄	DO 1 ₃	DO 1 ₂	DO 1 ₁	DO 1 ₀
	1	-	-	-	-	-	-	-	-

* The scheduled diagnostic information changes every 125 ms between Slot 1 and Slot 2, if both slots send active diagnostics.

Legend:

AI	Analog Input	MR	Measurement Value Range Error
CFG	Configuration Error	OC	Open Circuit
COM	Communication Failure	S1	Slot 1
DIA	Diagnostics Active	S2	Slot 2
DI	Digital Input	SC	Short Circuit/Overcurrent
DO	Digital Output	VI Low	VI Voltage
FCE	Force Mode Active	VO Low	VO Voltage

Modbus® TCP Register Mapping

	REG	Bit 15	Bit 14	Bit 13	Bit 12	Bit 11	Bit 10	Bit 9	Bit 8	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Inputs (RO)	0x0000	AI 1 ₀															
	0x0001	AI 1 ₁															
	0x0002									DI 2 ₇	DI 2 ₆	DI 2 ₅	DI 2 ₄	DI 2 ₃	DI 2 ₂	DI 2 ₁	DI 2 ₀
Status (RO)	0x0003	-	FCE	-	-	CFG	COM	VI low	-	VO low	-	-	-	-	-	-	DIA
Diag. (RO)	0x0004	-	-	-	-	-	-	-	-	-	-	-	-	-	-	S2 DIA	S1 DIA
Outputs (RW)	0x0800	-	-	-	-	-	-	-	-	DO 2 ₇	DO 2 ₆	DO 2 ₅	DO 2 ₄	DO 2 ₃	DO 2 ₂	DO 2 ₁	DO 2 ₀
I/O Diag. (RO)	0xA000	-	-	-	-	-	SCAI 1 ₁	OCAI 1 ₁	MRAI 1 ₁	-	-	-	-	-	SCAI 1 ₀	OCAI 1 ₀	MRAI 1 ₀
	0xA001	SCDO 2 ₇	SCDO 2 ₆	SCDO 2 ₅	SCDO 2 ₄	SCDO 2 ₃	SCDO 2 ₂	SCDO 2 ₁	SCDO 2 ₀	SCDI 2 ₇	SCDI 2 ₆	SCDI 2 ₅	SCDI 2 ₄	SCDI 2 ₃	SCDI 2 ₂	SCDI 2 ₁	SCDI 2 ₀

PROFINET® Process Data

	BYTE	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Inputs	0	AI 1 ₀ LSB							
	1	AI 1 ₀ MSB							
	2	AI 1 ₁ LSB							
	3	AI 1 ₁ MSB							
	4	DI 2 ₇	DI 2 ₆	DI 2 ₅	DI 2 ₄	DI 2 ₃	DI 2 ₂	DI 2 ₁	DI 2 ₀
	5	-	-	-	-	-	-	-	-
Outputs	0	DO 1 ₇	DO 1 ₆	DO 1 ₅	DO 1 ₄	DO 1 ₃	DO 1 ₂	DO 1 ₁	DO 1 ₀
	1	-	-	-	-	-	-	-	-