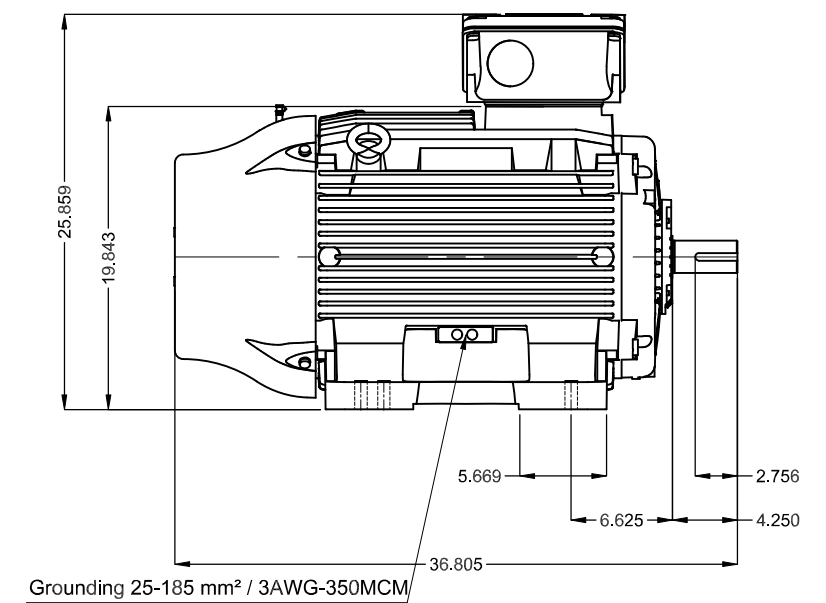
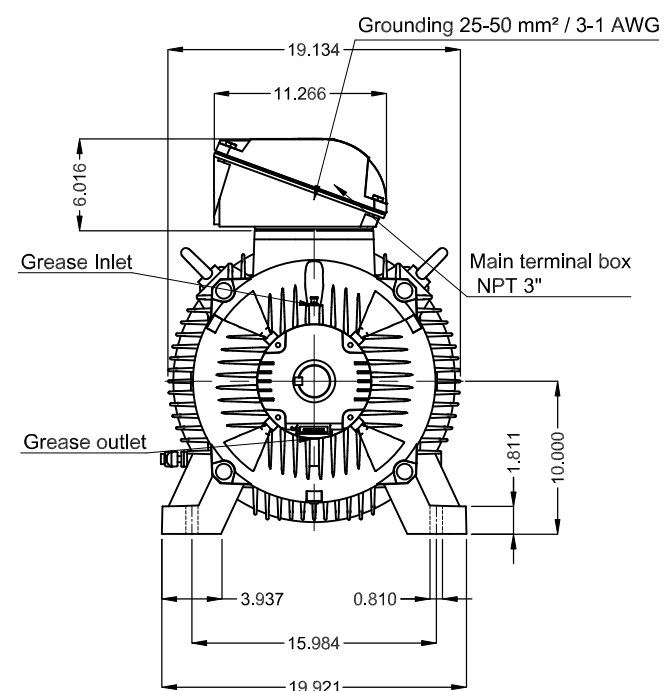
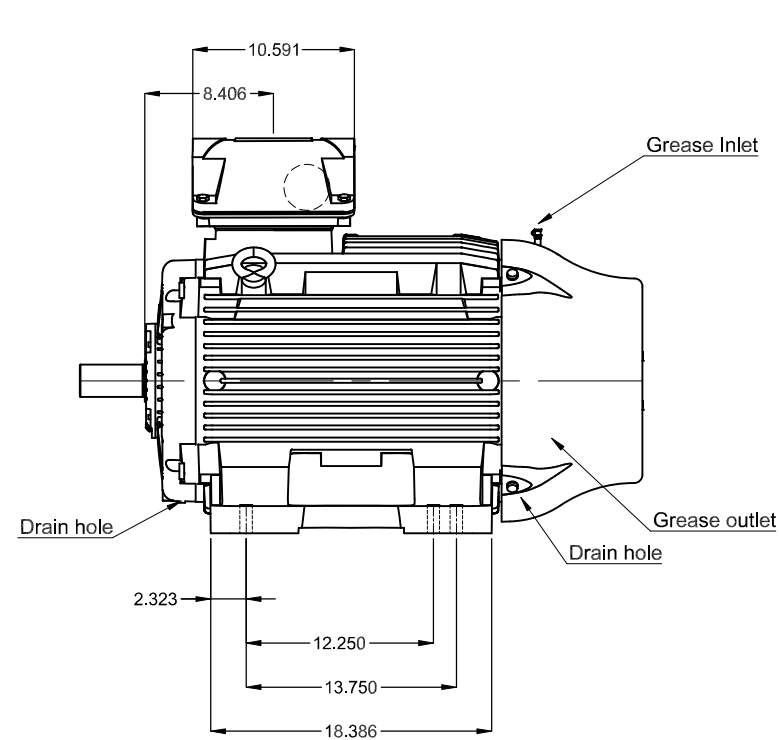


100 HP 04 Poles 60 Hz										A
						HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	 THREE PH. MOTOR W22 NEMA PREM. EFF. FRAME 404/5TS IP55 TEFC				PREVIEW WDD 00				
CHECKED										
RELEASED										
REL. DATE						SHEET		/		