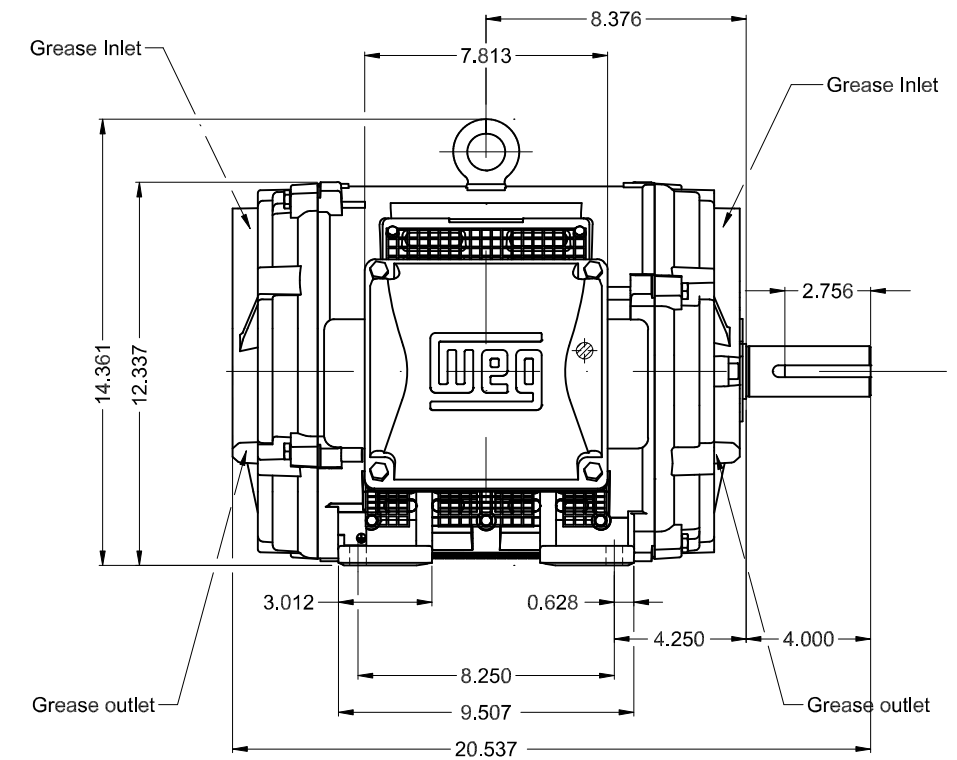
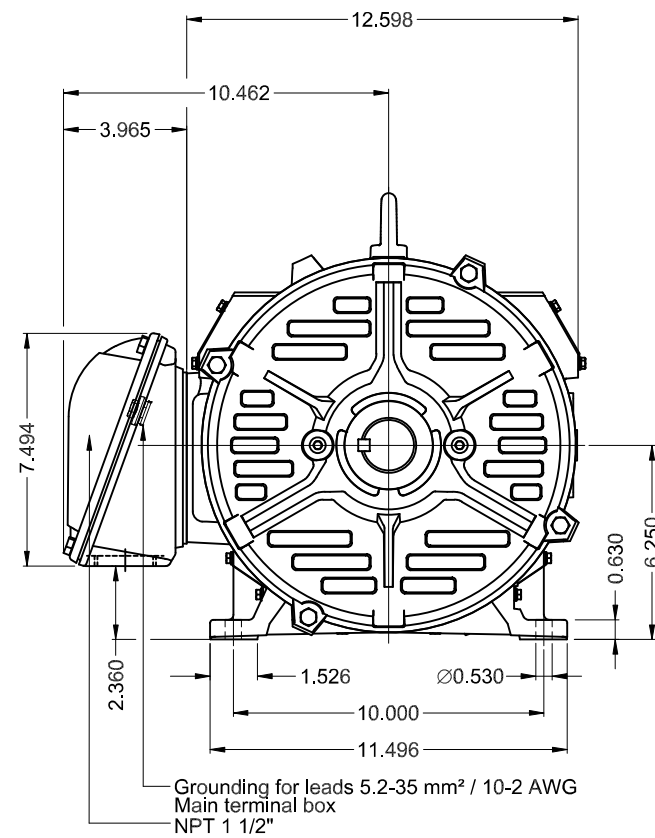


20 HP 02 Poles 60 Hz										A
										1:6
							HYBRISUSER			
ECM		LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR W40 NEMA PREM. EFF. FRAME 254T IP23 ODP					PREVIEW WDD 00		
CHECKED										
RELEASED										
REL. DATE			WMO	Jaraguá do Sul			Product Engineering		SHEET	1 / 1