


40 HP 04 Poles 60 Hz		A	
		1:8	
		00	
ECM	LOC	SUMMARY OF MODIFICATIONS	
EXECUTED	HYBRISUSER	THREE PH. MOTOR W40 NEMA PREM. EFF.	
CHECKED		FRAME 324TS IP23 ODP	
RELEASED			
REL. DATE		WMO Jaragua do Sul Product Engineering	
		PREVIEW	
		WDD 00	
		SHEET 1 / 1	
		XME	

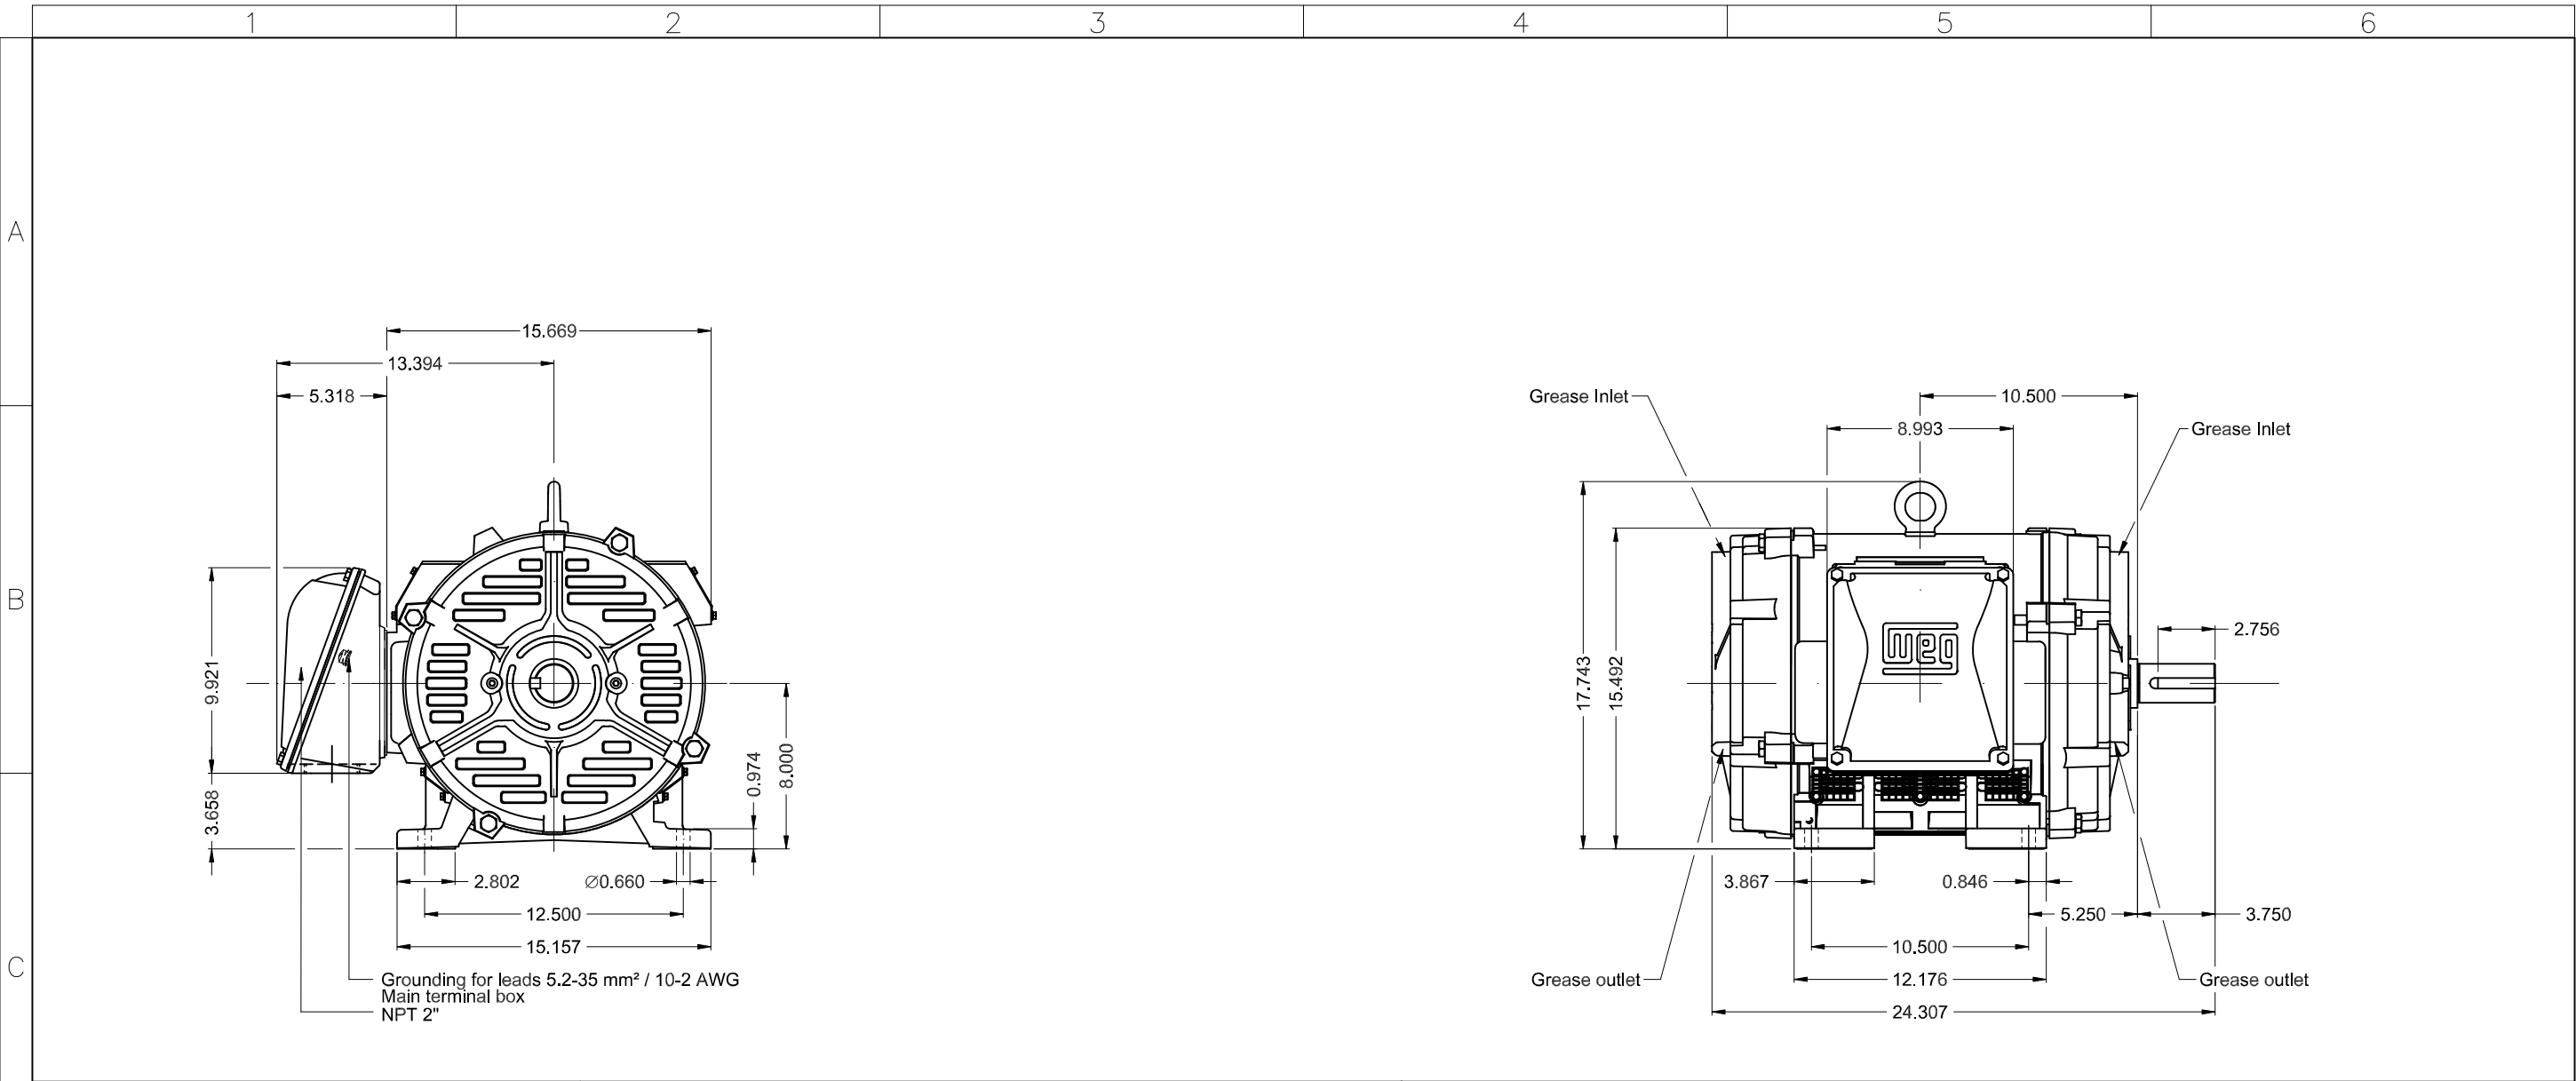