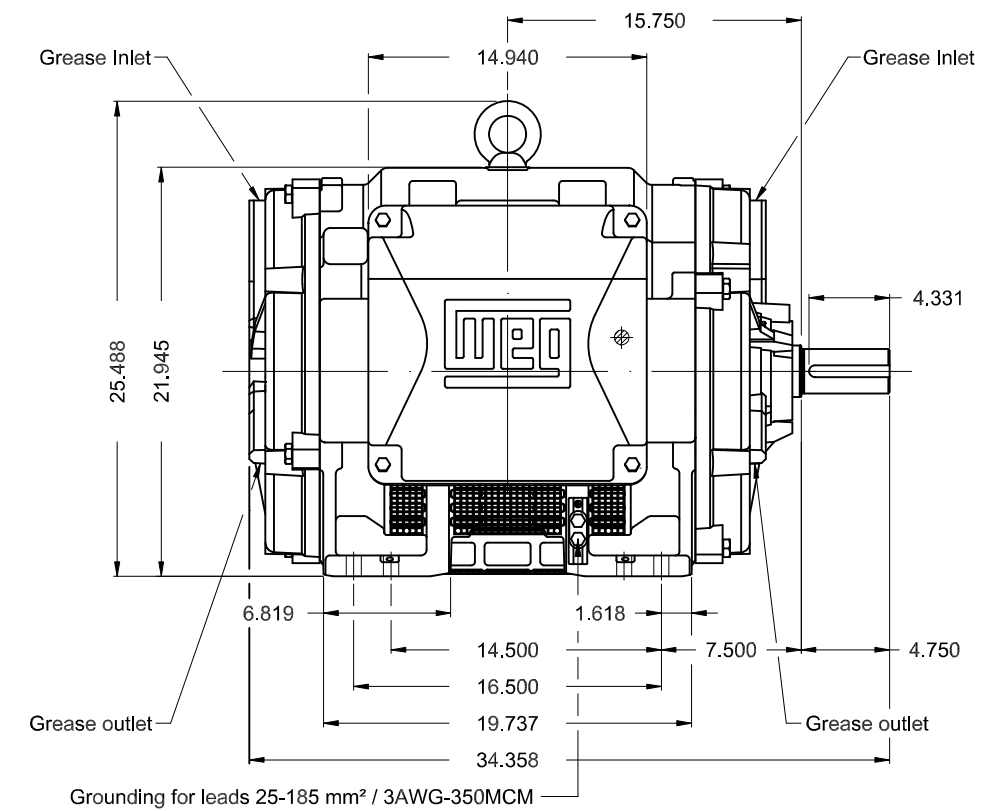
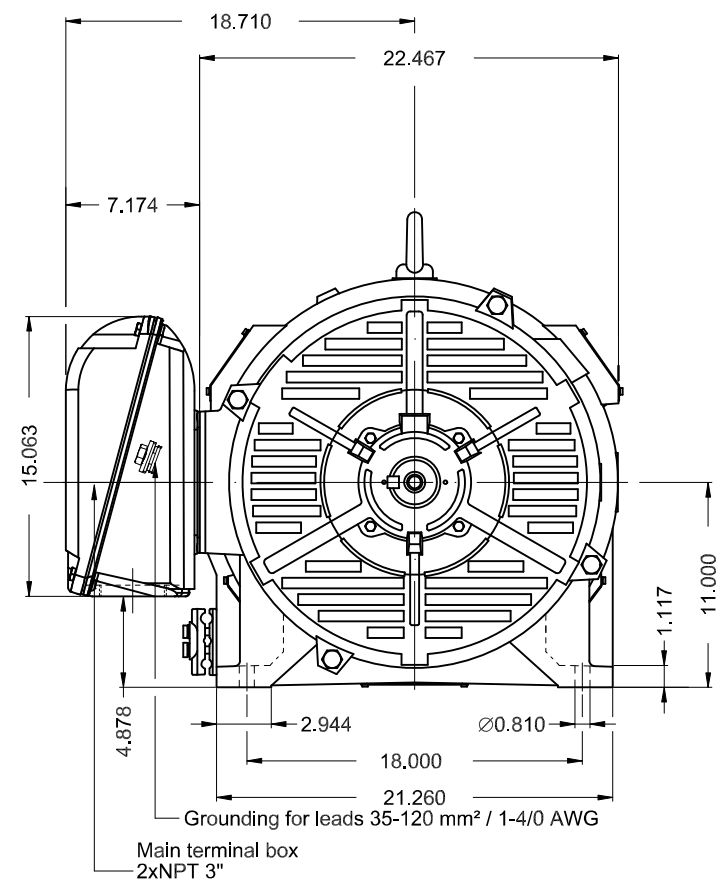


250 HP 02 Poles 60 Hz										A		
										1:10		
							HYBRISUSER				00	
ECM		LOC		SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED		HYBRISUSER				THREE PH. MOTOR W40 NEMA PREM. EFF. FRAME 444/5TS IP23 ODP			PREVIEW WDD 00			
CHECKED												
RELEASED												
REL. DATE				WMO		Jaraguá do Sul		Product Engineering		SHEET		1 / 1