
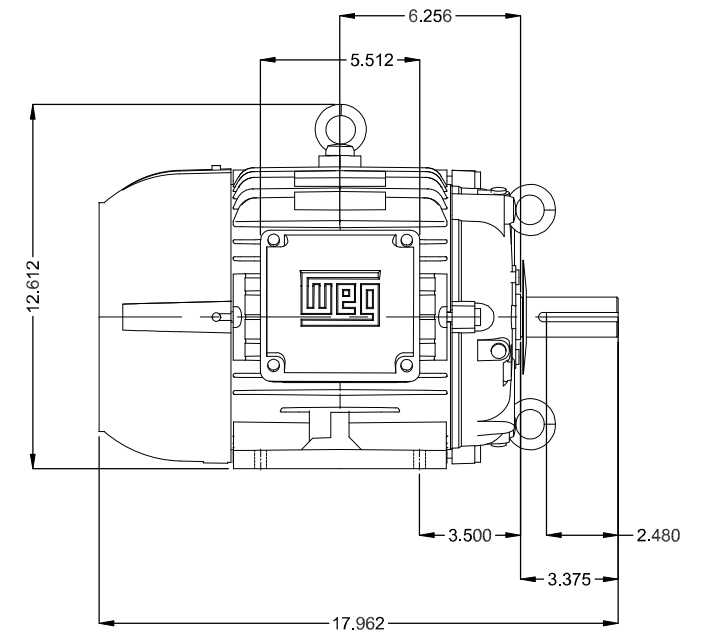
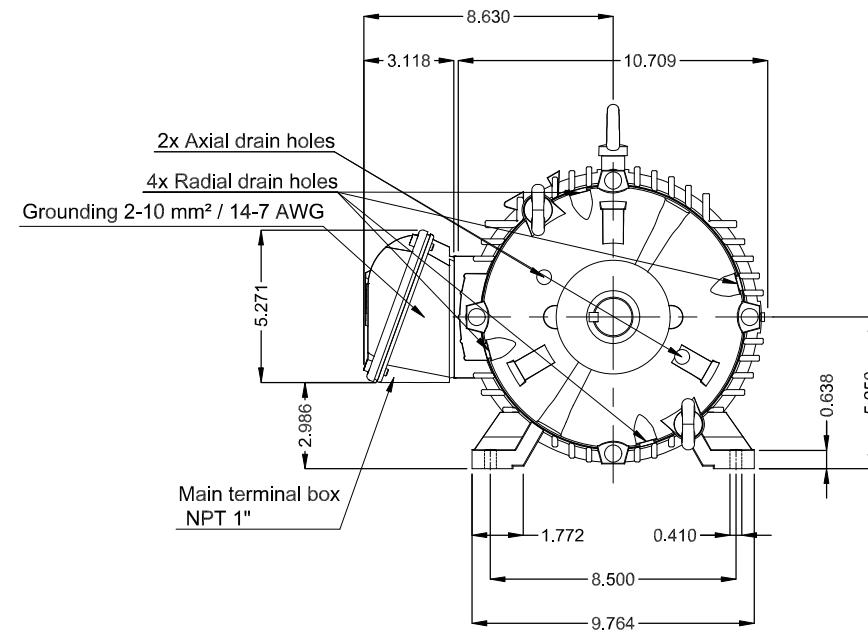


3 HP 06 Poles 60 Hz										A	
		HYBRISUSER								00	
ECM		LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR COOLING TOWER W22 NEMA PREM. EFF. FRAME 213T IP55 TEFC					PREVIEW			
CHECKED											
RELEASED											
REL. DATE											
						SHEET		/			

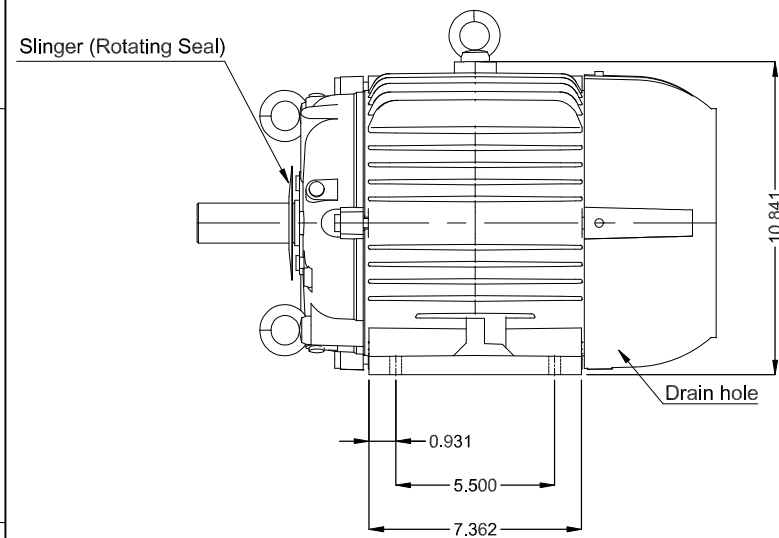