
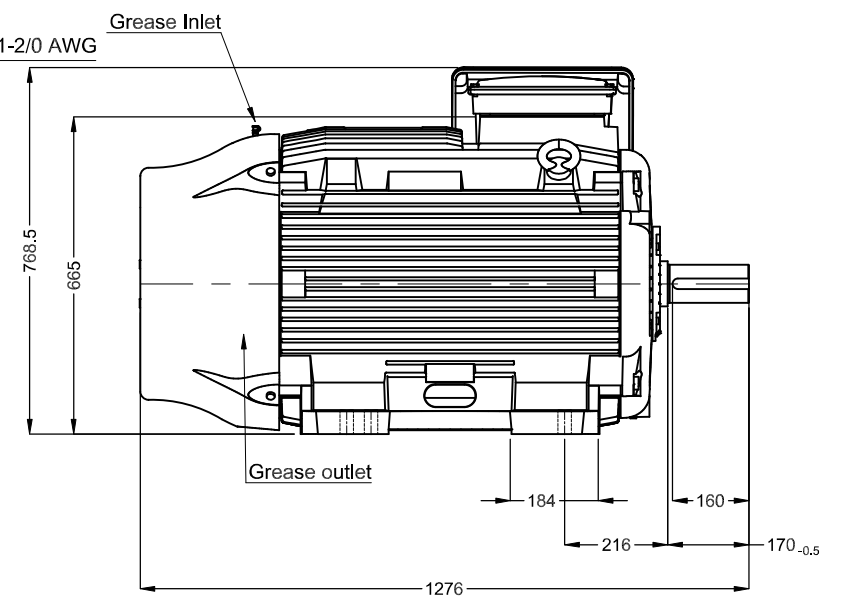
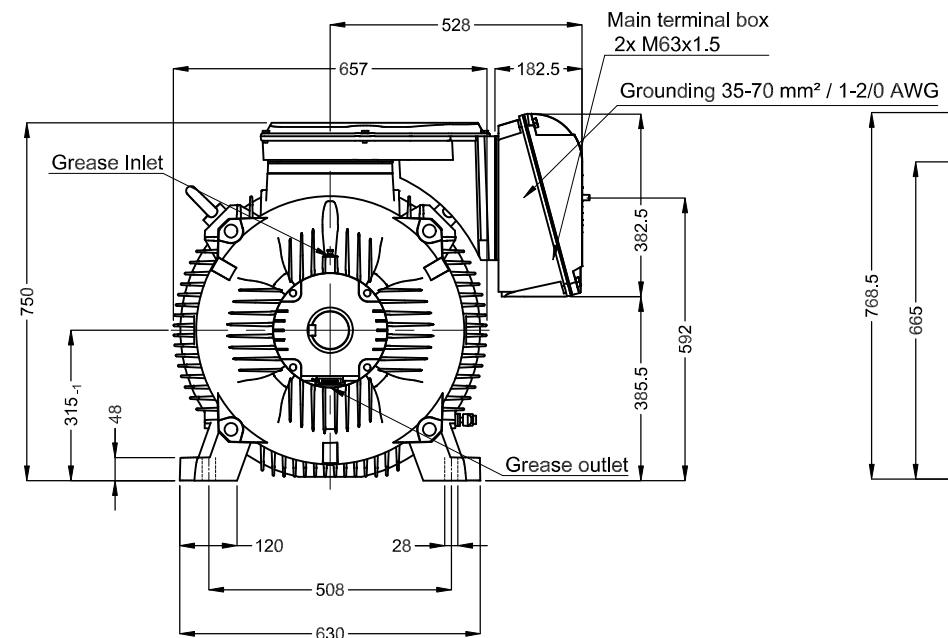


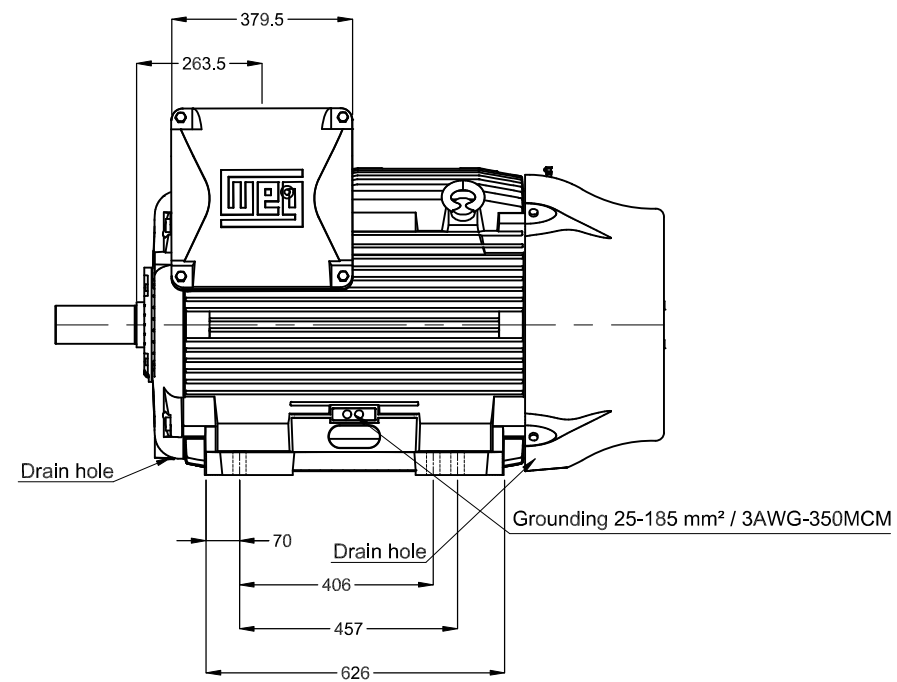

100 HP 06 Poles 60 Hz										A
						HYBRISUSER				00
ECM		LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	 	THREE PH. MOTOR W22 IE3 FRAME 315S/M IP55 TEFC			PREVIEW WDD 00				
CHECKED										
RELEASED										
REL. DATE						SHEET		/		