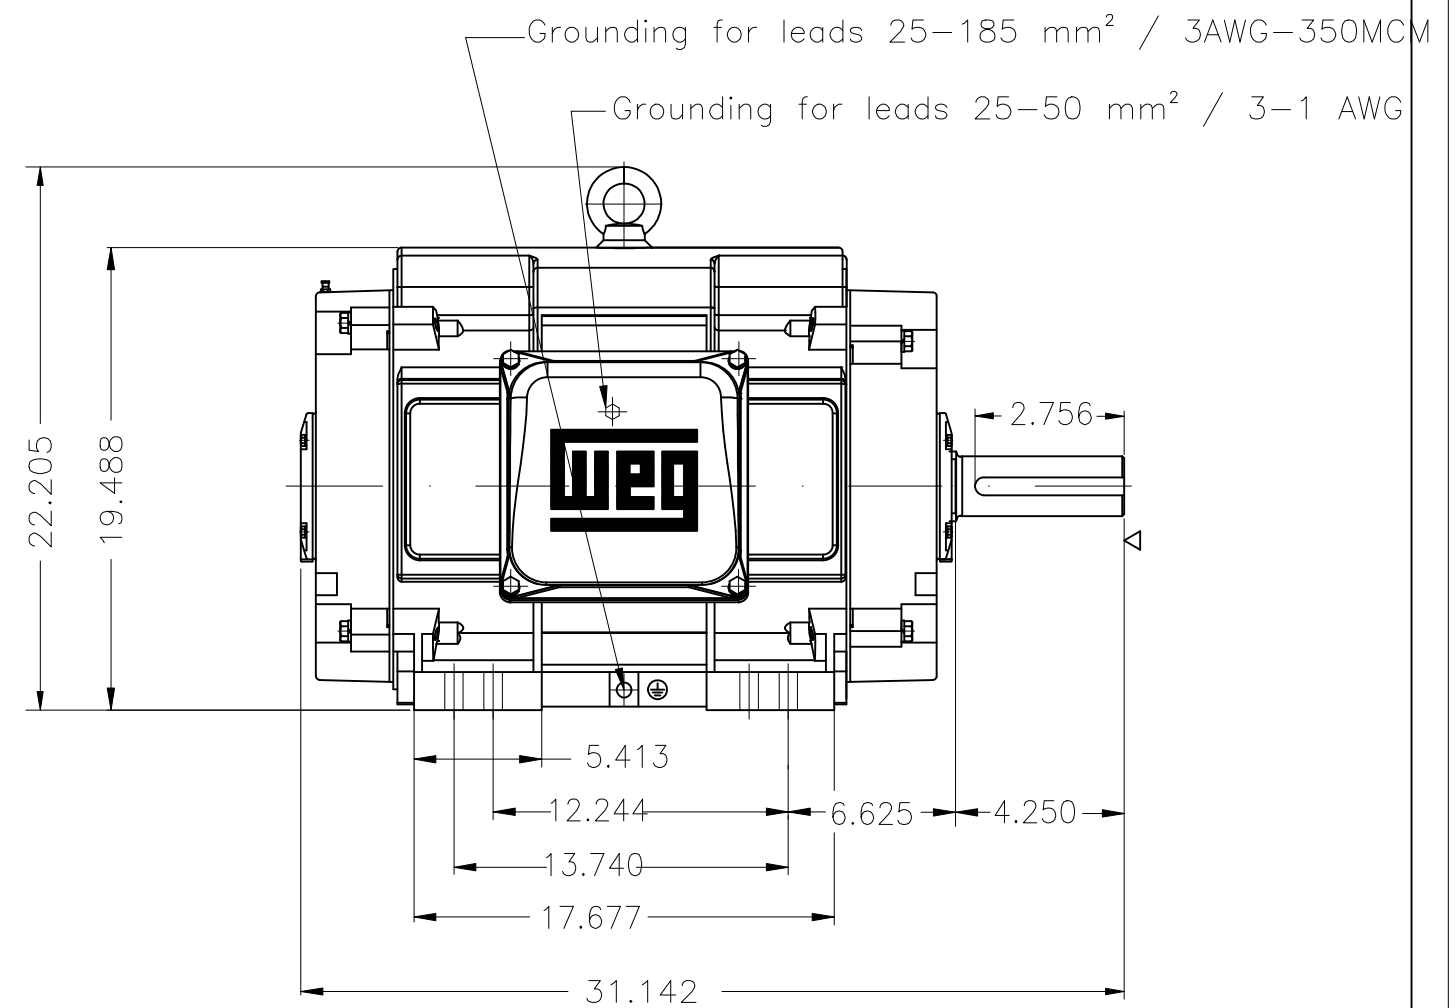
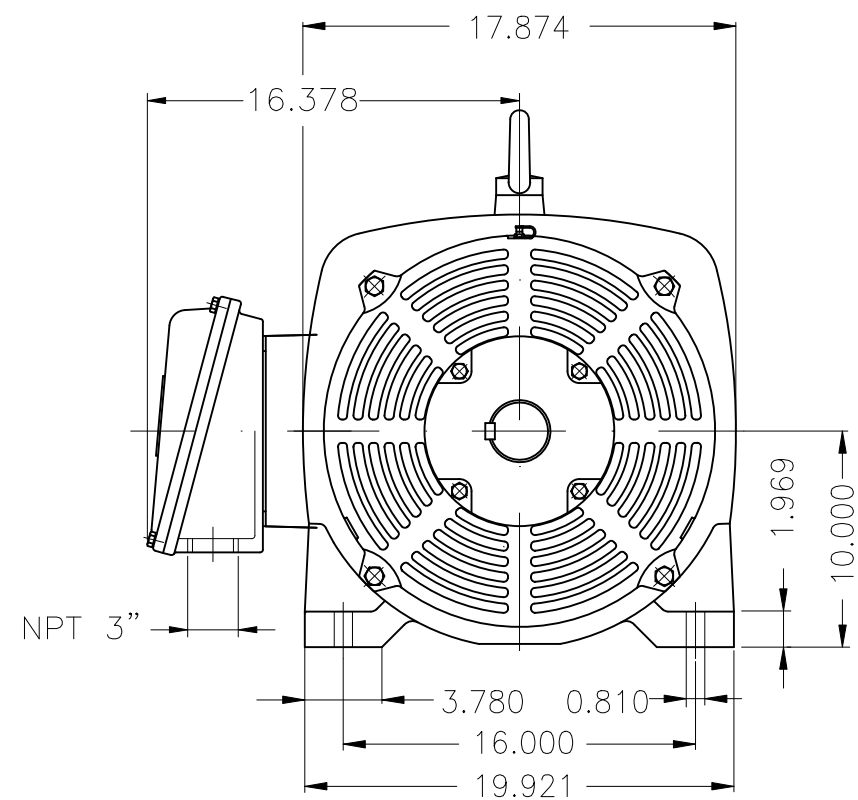


Certification UL/FIRE PUMP
Color RAL 3002
Painting plan 203A
Mounting B3R(D)

125 HP 02 Poles 60 Hz							A
			HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS	EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR GENERAL HIGH EFF. FRAME 404/5TS IP23 ODP		PREVIEW WDD 00		
CHECKED							
RELEASED							
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1	