




D E										
	30 HP 02 Poles 60 Hz									
				HYBRISUSER						00
	ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
	EXECUTED	HYBRISUSER		THREE PH. MOTOR GENERAL HIGH EFF. FRAME 284TS IP23 ODP			PREVIEW WDD 00			
	CHECKED									
	RELEASED									
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1				

Certification UL/FIRE PUMP
Color RAL 3002
Painting plan 203A
Mounting B3R(D)

DE Shaft End

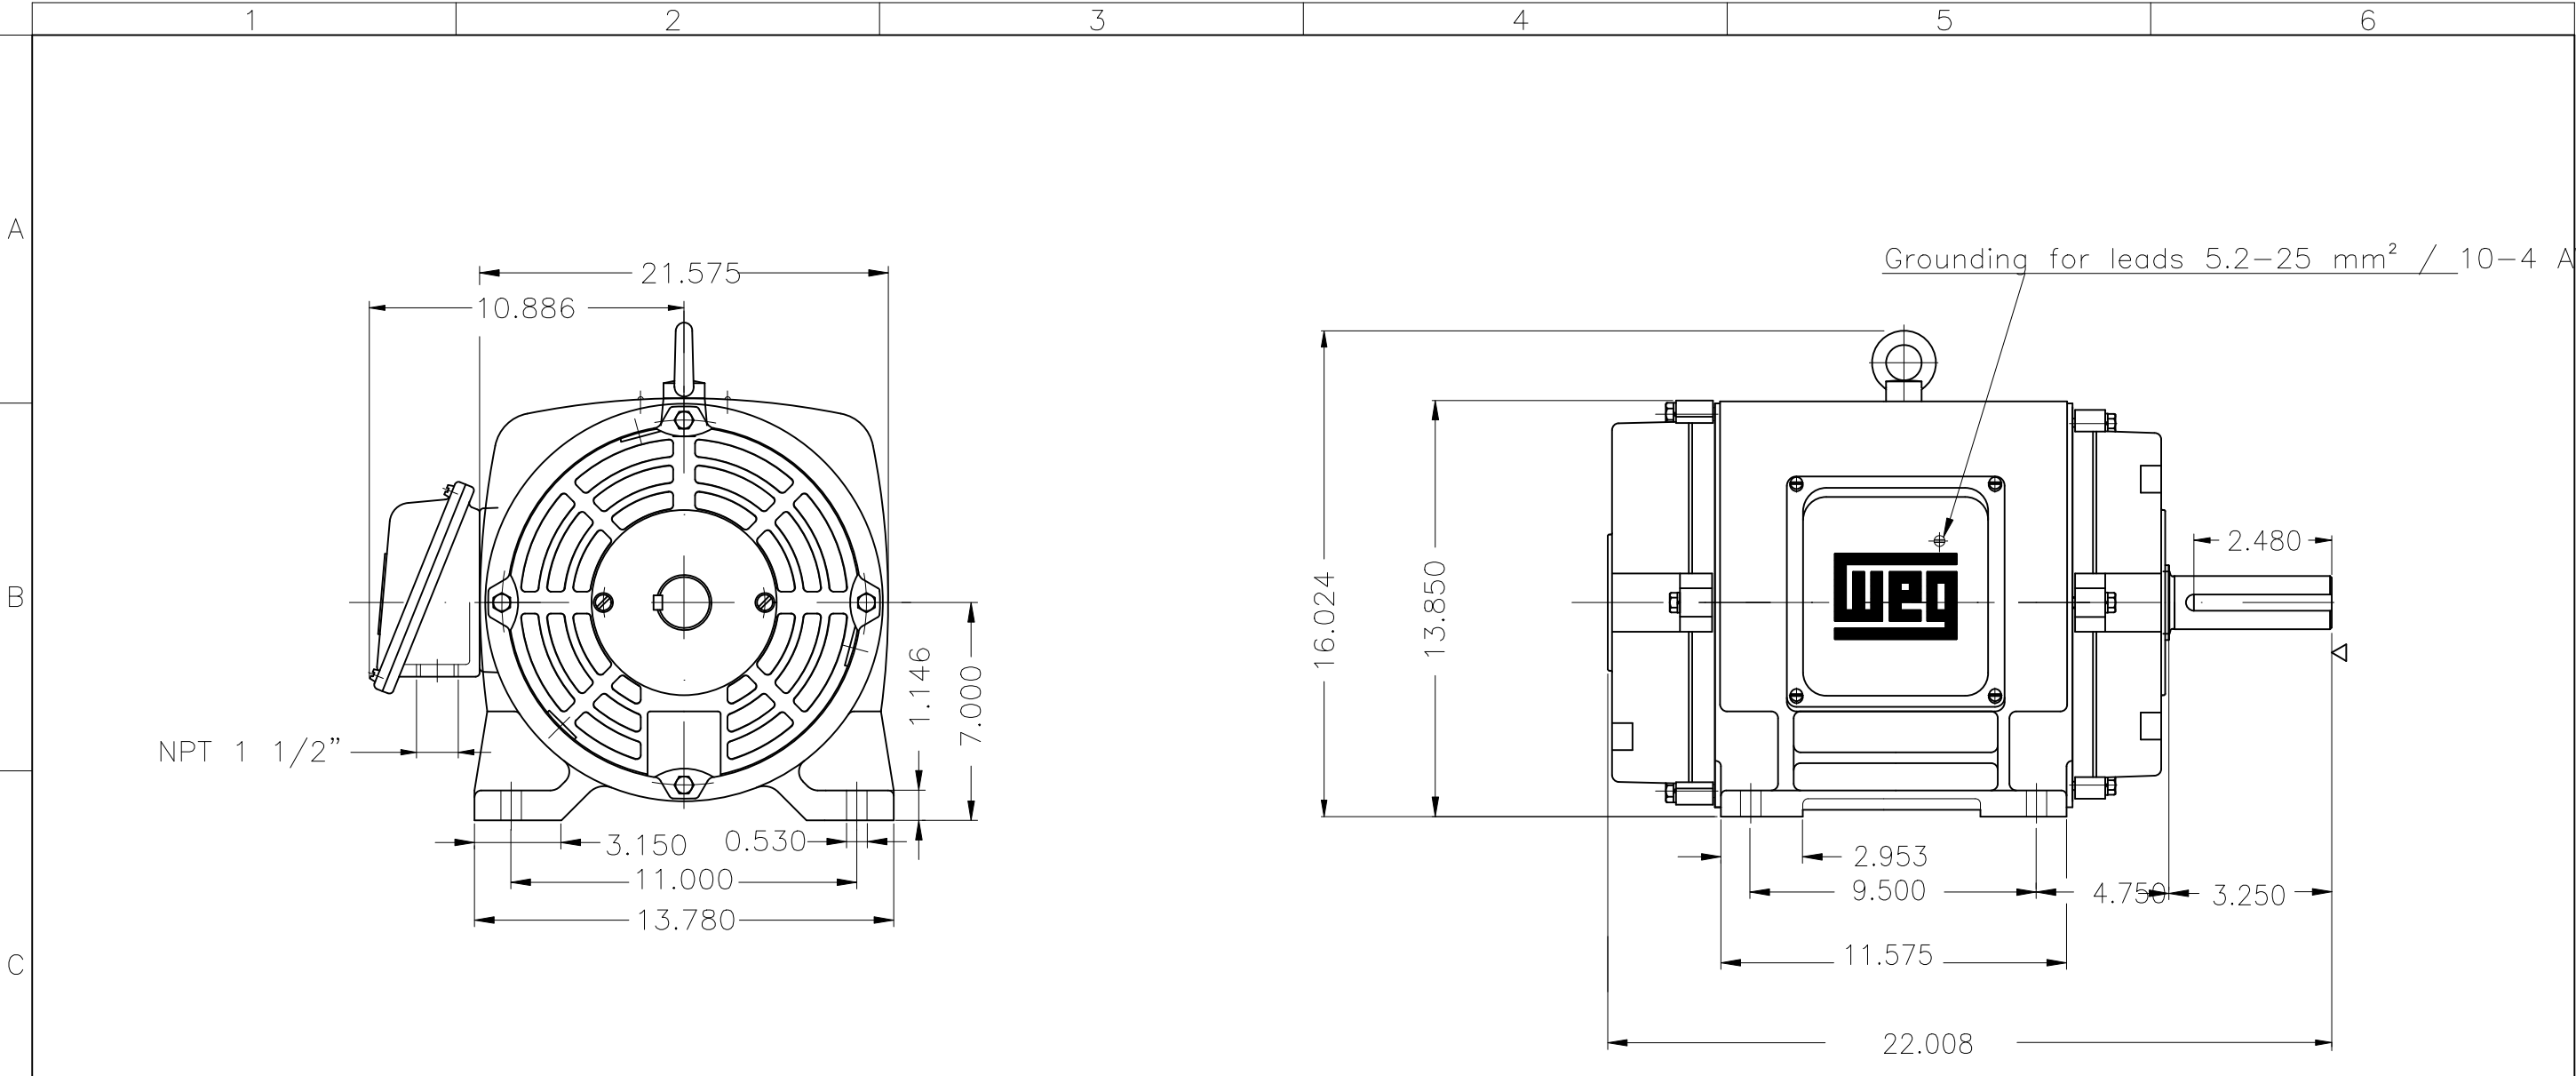