
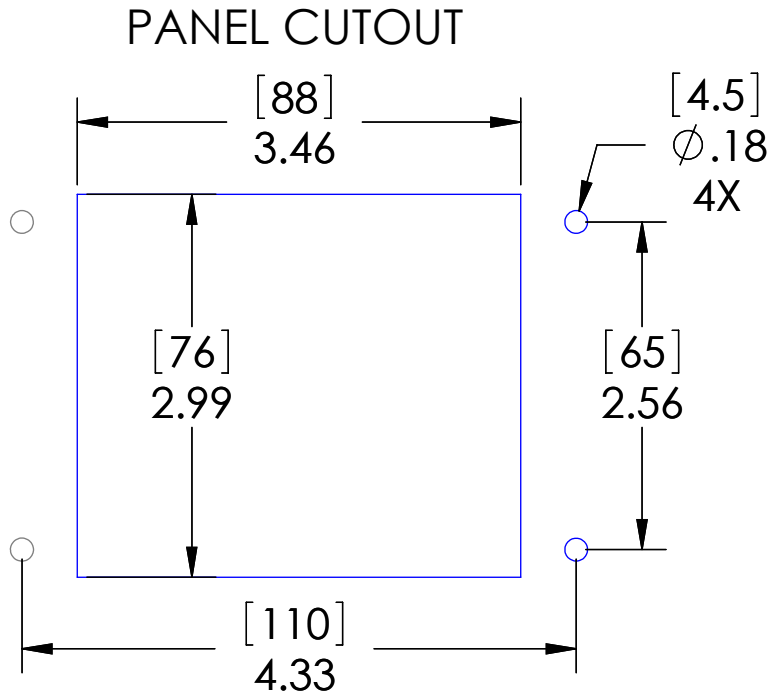


SHIELDED CAT 6A RJ45  
CONNECTOR JACK TO JACK

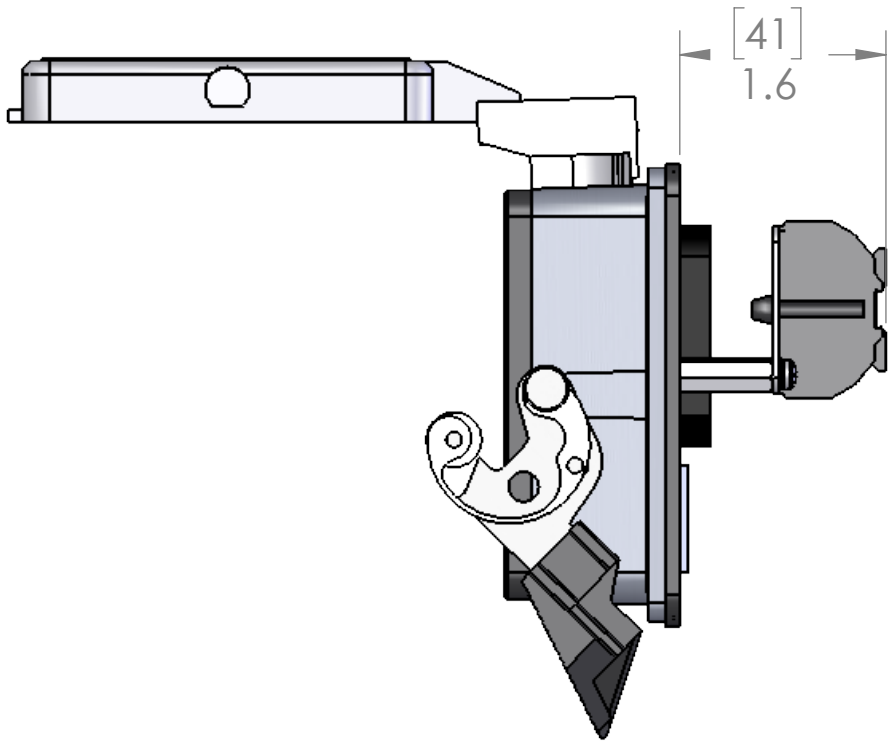

MOUNTING KIT ORDERED  
SEPARATELY CONTAINS  
M4x0.7 SS SCREW, NYLON WASHER,  
SPLIT LOCKWASHER AND M4 NUT  
P/N: D-PIC-MT

**PROPRIETARY AND CONFIDENTIAL**  
THE INFORMATION CONTAINED IN THIS  
DRAWING IS THE SOLE PROPERTY OF  
MENCOM CORPORATION. ANY  
REPRODUCTION IN PART OR AS A WHOLE  
WITHOUT THE WRITTEN PERMISSION OF  
MENCOM CORPORATION IS  
PROHIBITED.

HOUSING MATERIALS		PIC RATINGS/SPECIFICATIONS	
BODY:	EPOXY COATED DIE CAST ALUMINUM	VOLTS:	125V
GASKET:	THERMOPLASTIC ELASTOMER	AMPS:	15A
HANDLE:	POLYAMIDE	SCCR:	10kA
LEVERS:	STAINLESS STEEL	NEMA/UL   EN 60529:	4, 12   IP65
UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES AND [MM]		PANEL THICKNESS:	5.0mm max
		MOUNTING SCREW TORQUE:	0.8N-m
		TERMINAL BLOCK TORQUE:	0.5N-m
		INCOMING POWER WIRE SIZE:	0.25 - 2.5 sq mm / 24-12AWG
		WIRE STRIP LENGTH:	7 - 8 mm
UL LISTED ENCL. ACC. 5JR2		DRAWN BY	DCG
		DRAWN DATE	11/21/2018
		CHECKED BY	GO
		CHECK DATE	11/26/2018
		MENCOM CORPORATION	
		TITLE:	
		GFI; SHIELDED RJ45; 32	
		SIZE	DWG. NO.
		B	GF-RJ45S-NR-32
		SCALE: 2:3	REV D
		WEIGHT:	SHEET 1 OF 1

A device employing a 15 A or 20 A grounding type receptacle but no supplementary protector shall be protected by a fuse or circuit breaker that does not exceed the marked rating of the receptacle in the end use. When a fuse or circuit breaker rated less than the receptacle's rating is provided, a Marking shall be provided to indicate the maximum ampere rating of the protection provided.

These devices shall be mounted on enclosures having adequate strength and thickness and with adequate spacing provided. Seal rating is based on mounting to a surface that is clean, flat and smooth.